

► **Code Number**

20021002

► **Specifications**

Quiet, exposed, diaphragm type, chrome plated dual flush HET Flushometer and vitreous china dual flush HET floor mount fixture with the following features:

► **Flush Cycle**

Model WETS-2002.1002-1.6 /1.1 WES (Down 1.6 gpf/6.0 Lpf, Up 1.1 gpf/4.2 Lpf)

► **Flushometer Specification**


Quiet, diaphragm type, chrome plated closet Flushometer and vitreous china water closet with the following features:

- Lifting Handle UP initiates reduced flush (1.1 gpf/ 4.2 Lpf), eliminating liquid and paper waste, saving a ½- gallon of water
- Pushing Handle DOWN initiates full flush (1.6 gpf/ 6.0 Lpf), eliminating solid waste and paper
- Reduces water volume by up to 30% when activated UPWARDS
- Antimicrobial Coating on Handle protects against germs
- Distinctive Green ADA Compliant Metal Non-Hold- Open Handle with Triple Seal Handle Packing signifies Water Conserving Device
- Sweat Solder Adapter w/Cover Tube and Cast Wall Flange with Set Screw
- Includes (2) adhesive backed Metal Wall Plates etched w/Instructions
- 1" I.P.S screwdriver Bak-Chek® angle stop
- Diaphragm, Stop Seat and Vacuum Breaker to be molded from PERMEX® rubber compound for Chloramine resistance

Valve Body, Cover, Tailpiece and Control Stop shall be in conformance with ASTM Alloy Classification for Semi-Red Brass. Valve shall be in compliance to the applicable sections of ASSE 1037/ ASME A112.19.2/CSA B45.1

► **Fixture Specifications**

- Siphon jet flush
- 100% factory flush tested
- Vitreous china with Integral flushing rim
- Floor mounted elongated bowl
- 1 ½" I.P.S. top spud inlet
- 2 1/8" fully glazed trapway diameter
- Water closet compliant to the applicable sections of ASME A112.19.2/CSA B45.1
- Recommended seats:
- Bemis - 1955CT/1955SSCT & 2155CT/2155SSCT
- Church - 295CT/295SSCT & 2155CT/2155SSCT
- Compliant with Buy American Act when purchased as a combination
- Toilet seat not included
- Closet bolts and caps included

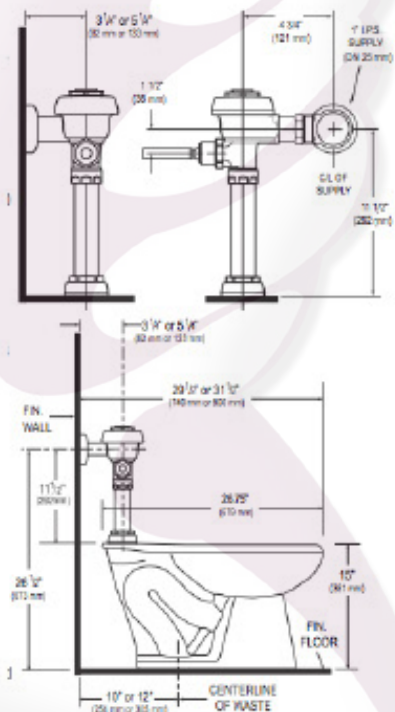

► **Plumbing System Requirements**

Maximum Static Pressure: 80 PSI

Minimum Flow Rate: 25 GPM

Minimum Flowing Pressure: 25 PSI

► **Compliance & Certifications**



This space for Architect/Engineer Approval